


CONSTRUCTION NOTES

1. ALL POURED-IN-PLACE CONCRETE SHALL BE CLASS 3000.
2. TRACER WIRE SHALL BE 14 AWG COPPER & SPLICES SHALL BE MADE WITH DIRECT BURY SPLICE KITS FROM 3M ELECTRICAL PRODUCTS DIVISION.
FOR (2) WIRE SPLICING USE PART No. 054007-09053 &
FOR (3) WIRE SPLICING USE PART No. 054007-09964.
3. LOCATION TAPE SHALL BE USED ON ALL NEW CONSTRUCTION. TAPE SHALL BE PLACED 1' BELOW FINISHED SURFACE.
4. IF RISER IS IN GRAVEL, CONCRETE, OR PAVEMENT, HOUSING & SHALL BE CAST IRON OLYMPIC FOUNDRY INC. OR EQUAL OR CONCRETE. OTHERWISE, USE HDPE
5. FOR PRESSURE TESTING ONLY, THE PVC SCREW-IN PLUG MAY BE SUBSTITUTED FOR A MORE PRESSURE RESISTANT SEAL FROM CARSON INDUSTRIES OR EQUAL.
6. THERE MUST BE CONTINUITY OF TRACER WIRES THROUGHOUT THE ENTIRE SUBDIVISION SO THAT A SINGLE CONNECTION TO A TRACER WIRE LOOP WILL BE SUFFICIENT TO LOCATE ALL SEWER PIPES & MANHOLES IN THE PROPOSED SUBDIVISION.

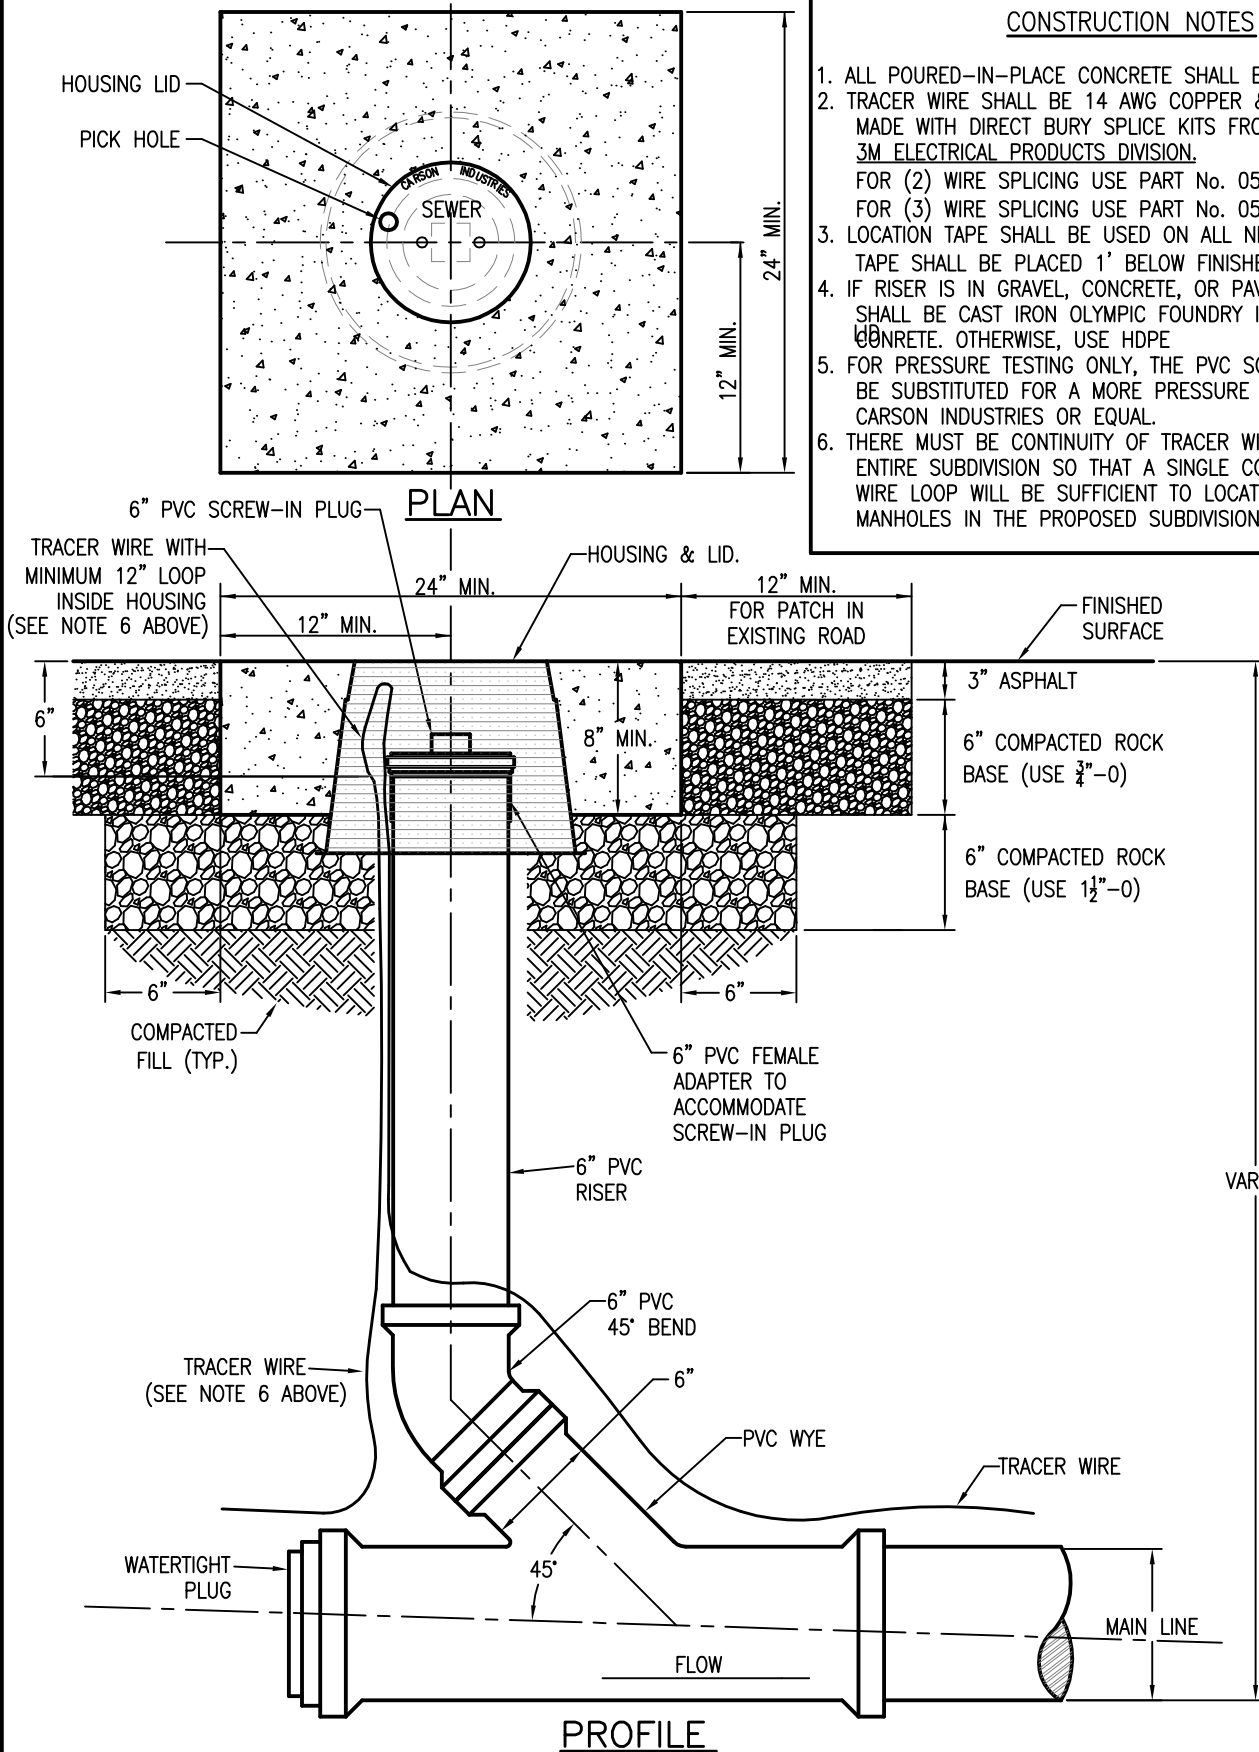

SCALE: N.T.S.

SOUTH SUBURBAN SANITARY DISTRICT

Drawn By: MDR
Adkins Consulting Engineers, Inc.
Approved By SSSD Manager:
Bob McDaniel

**STANDARD
CLEANOUT**

Date: JANUARY 2006
Dwg. No.: **SD-5**